

- **Sydney** F3 3-29 Birnie Avenue Lidcombe NSW 2141
Telephone: (02) 9807 6155 Facsimile: (02) 9808 2033
- **Melbourne** 3-5 Dissik Street Cheltenham VIC 3192
Telephone: (03) 9532 1233 Facsimile: (03) 9553 3502
- **Perth** 36 Division Street Welshpool WA 6106
Telephone: (08) 9358 1788 Facsimile (08) 9358 1733

- **Brisbane** 32 Duntroon St Brendale QLD 4500
Postal Address: PO Box 642 Virginia QLD 4014
Telephone: (07) 3863 0749 Facsimile (07) 3863 0795
- **Rockhampton** Shop 3, 76 Hollingsworth Street North Rockhampton QLD 4701
Postal Address PO Box 1124 North Rockhampton QLD 4701
Telephone: (07) 4921 0978 Facsimile (07) 4921 0981


1 October 2025

Subject: Flange Dimensions for 300A and 425A Restrained Receptacles.


The flange dimensions for the 300A and 425A Restrained Receptacles are $160 \pm 3 \text{ mm} \times 203 \pm 3 \text{ mm}$, which has a slight variation from the nominal size specified in AS/NZS 1299:2009 ($152 \text{ mm} \times 203 \text{ mm}$). For correct installation, please refer to the instruction TRP-2-2, which details the suitable enclosure mounting pad in accordance with AS 1299. This document can be accessed in the support section under: Certification Drawings 300-425A Restrained Receptacles.

300/425A Restrained Receptacle Flange Dimensions

As Per CMI Certified Drawing

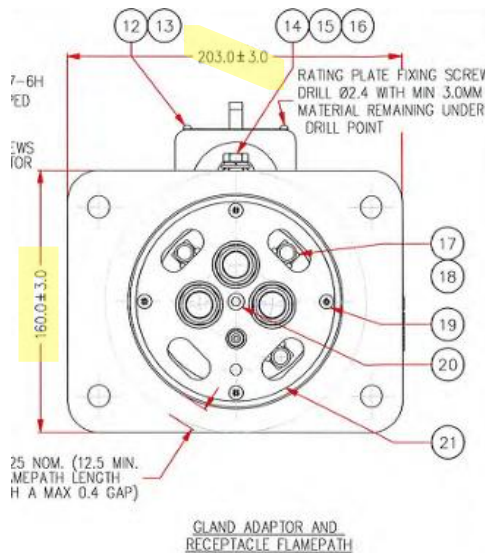

As Per AS/NZS 1299:2009

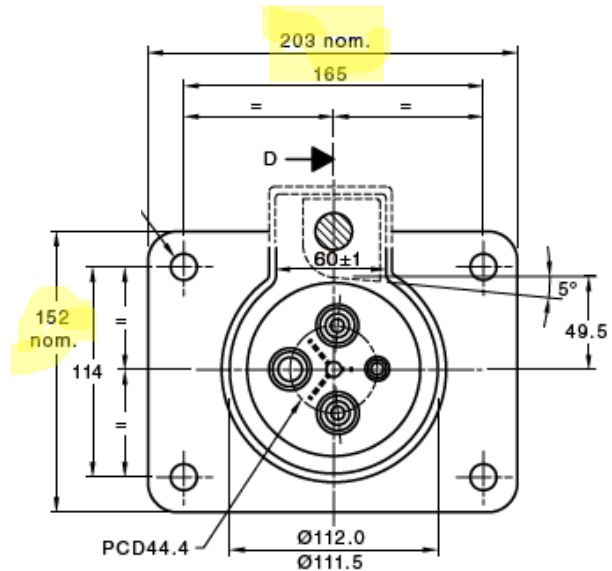

300/425A Restrained Receptacle Mounting Template as per AS/NZS 1299:2009

